


NOTAS (NOTES):

- 1- DIFERENCIA DE CONEXION APROXIMADA (CONNECTION DIFFERENCE APPROXIMATELY) $4^{\circ}\text{C}\pm 2^{\circ}\text{C}$
- 2- MAXIMA TEMPERATURA DEL CUERPO (MAXIMUM BODY TEMPERATURE) 85°C
- 3- CAPACIDAD DE MANIOBRA (POWER SUPPLY) 16A/400V~
- 4- LIMITES DE TEMPERATURA EN EL BULBO (TEMPERATURE LIMITS ON THE PHIAL) -10 Y 130°C
- 5- LAS TEMPERATURAS INDICADAS SON VALORES DE DESCONEXION (THE INDICATED TEMPERATURES ARE DISCONNECTION VALUES)
- 6- EJE DIBUJADO EN POSICION "0" (SPINDLE DRAW IN "0" POSITION)
- 7- FASTON 6,3 x 0,8 DIN 46244
- 8- LAS TEMPERATURAS SON MEDIDAS INTRODUCIENDO EL BULBO Y 80/100mm DE CAPILAR EN EL BAÑO A TEMPERATURA AMBIENTE DE $23\pm 3^{\circ}\text{C}$ (TEMPERATURES ARE MEASURED INTRODUCING THE PHIAL AND 80/100mm CAPILLARY IN THE BATH AT AMBIENT TEMPERATURE OF $23\pm 3^{\circ}\text{C}$)

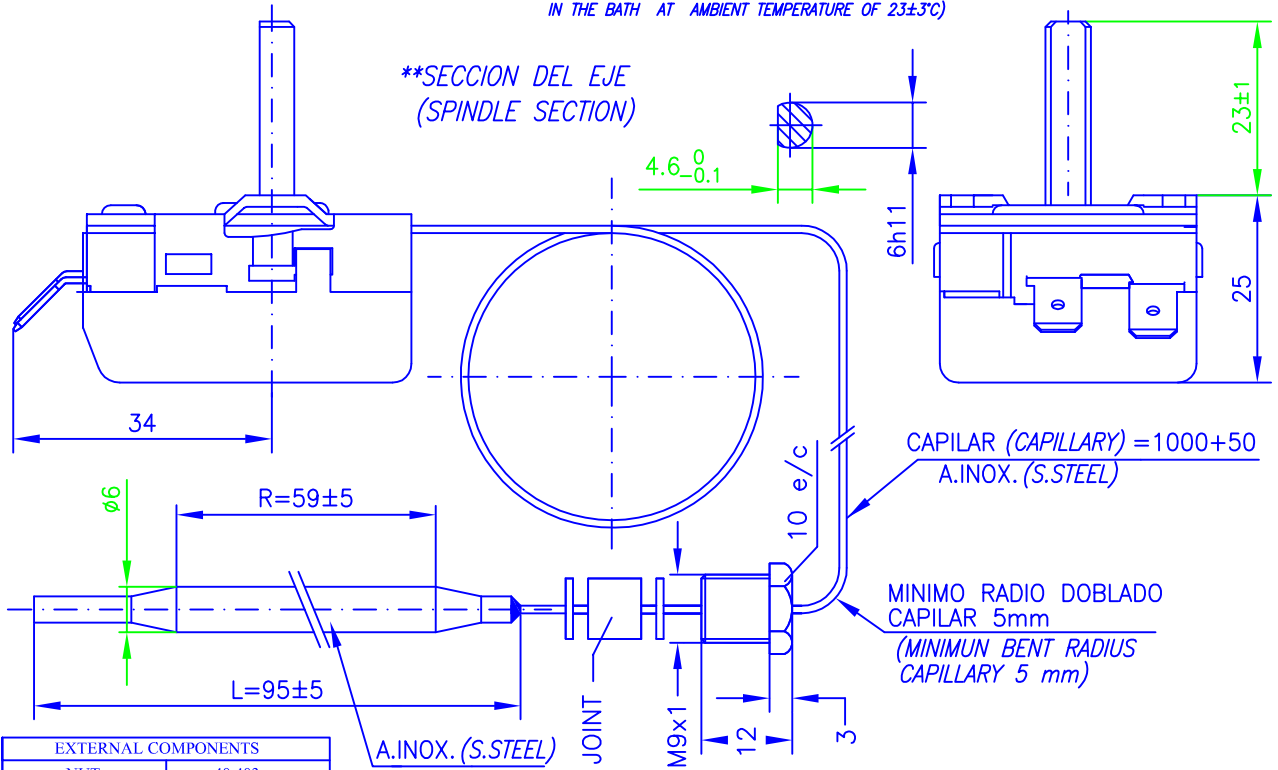

EXTERNAL COMPONENTS	
NUT	40.403
THREADED NUT	40.404
WASHER	2X40.406

CAPILAR (CAPILLARY) = 1000+50
A.INOX. (S.STEEL)

MINIMO RADIO DOBLADO
CAPILAR 5mm
(MINIMUM BENT RADIUS
CAPILLARY 5 mm)

EXTERNAL COMPONENTS	
NUT	40.403
THREADED NUT	40.404
WASHER	2X40.406

EN ESTOS AGUJEROS LA MAX. LONG. DEL TORNILLO SERA DE 11 mm MAS EL ESPESOR DE LA CHAPA
(IN THESE HOLES, THE MAX. SCREW LENGTH WILL BE 11mm PLUS PLATE THICKNESS)

(IN THESE HOLES, THE MAX. SCREW LENGTH WILL BE 11mm PLUS PLATE THICKNESS)

CIRCUITO ELECTRO
POSICION DE DESCONEXION
(ELECTRIC DIAGRAM)
(OPEN POSITION)






DIAGRAMA DE TEMPERATURAS
(TEMPERATURE DIAGRAM)

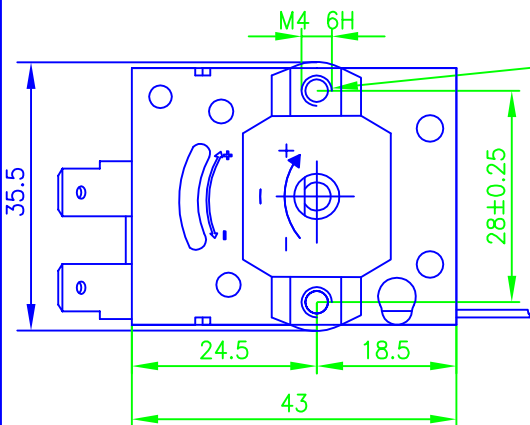

N-490X ** N-40.860/1 (1.41)		DIBUJO	REVIS.	FECHA
EDICION		L.FDEZ		29/07/99
REVISIONES	A) Actualizado.	Sergio		04/07/02
	B) Cambio a nueva brida.	K.Arnal		27/10/04
	C) External component table has been added	E.K.	V.B.C.	11.08.2015
ESCALA	1:1			
TERMOSTATO (THERMOSTAT)				

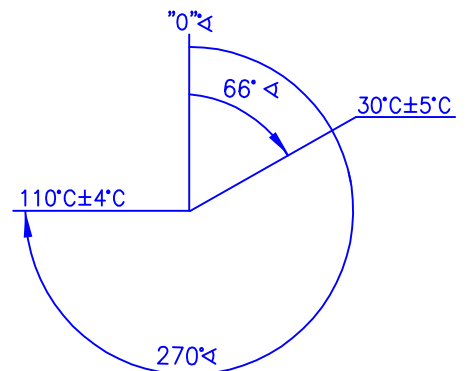

NT-132 PM